


Division of Building Regulation

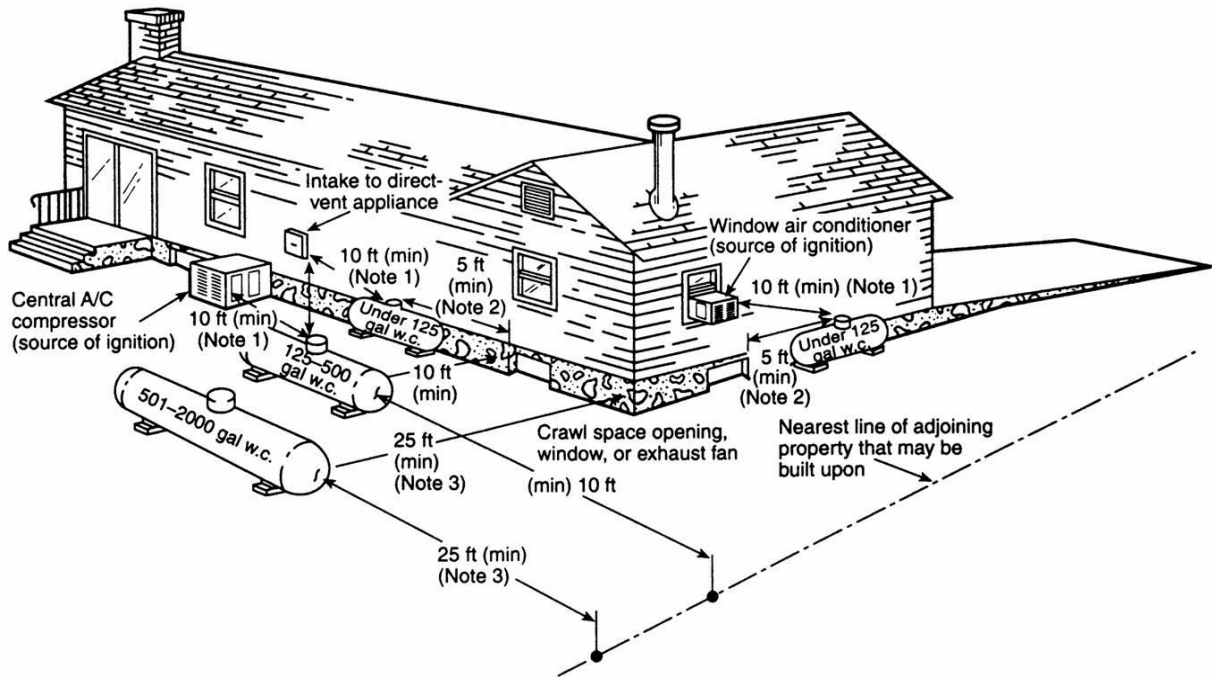

Notes:

The referenced code sections in the following come from NFPA 58-2011

- 1: Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft. from any external source of ignition (e.g., open flame, window A/C, compressor), intake to direct-vented gas appliances, or intake to a mechanical ventilation system. Refer to 6.3.9.
- 2: The distance measured horizontally from the point of discharge of a container pressure relief valve to any building opening below the level of such discharge shall be in accordance with table 6.3.8.
- 3: This distance may be reduced to no less than 10 ft for a single container of 1200 gallon water capacity or less, provided such container is at least 25 ft from any other LP-Gas container of more than 125 gallons water capacity. Refer to 6.3.3.